

Cod. 387201

© Copyright 2017 Caleffi



Il kit permette di poter smontare dalla valvola il vitolo completo con l'impianto in pressione (**max 5 bar**) in caso di interventi per manutenzione o sostituzione.




Si consiglia di eseguire le procedure con temperature impianto basse per evitare possibili ustioni o difficoltà di manovra sui componenti metallici.

The kit allows to disassemble the complete headwork from the valve body with the system still in pressure (max. 5 bar), in case of maintenance or replacement.




It is recommended to perform the procedures with low system temperatures to avoid possible burns or problems when operating on metal components.

**PROCEDURA PER VALVOLE TERMOSTATIZZABILI
PROCEDURE FOR CONVERTIBLE RADIATOR VALVES**

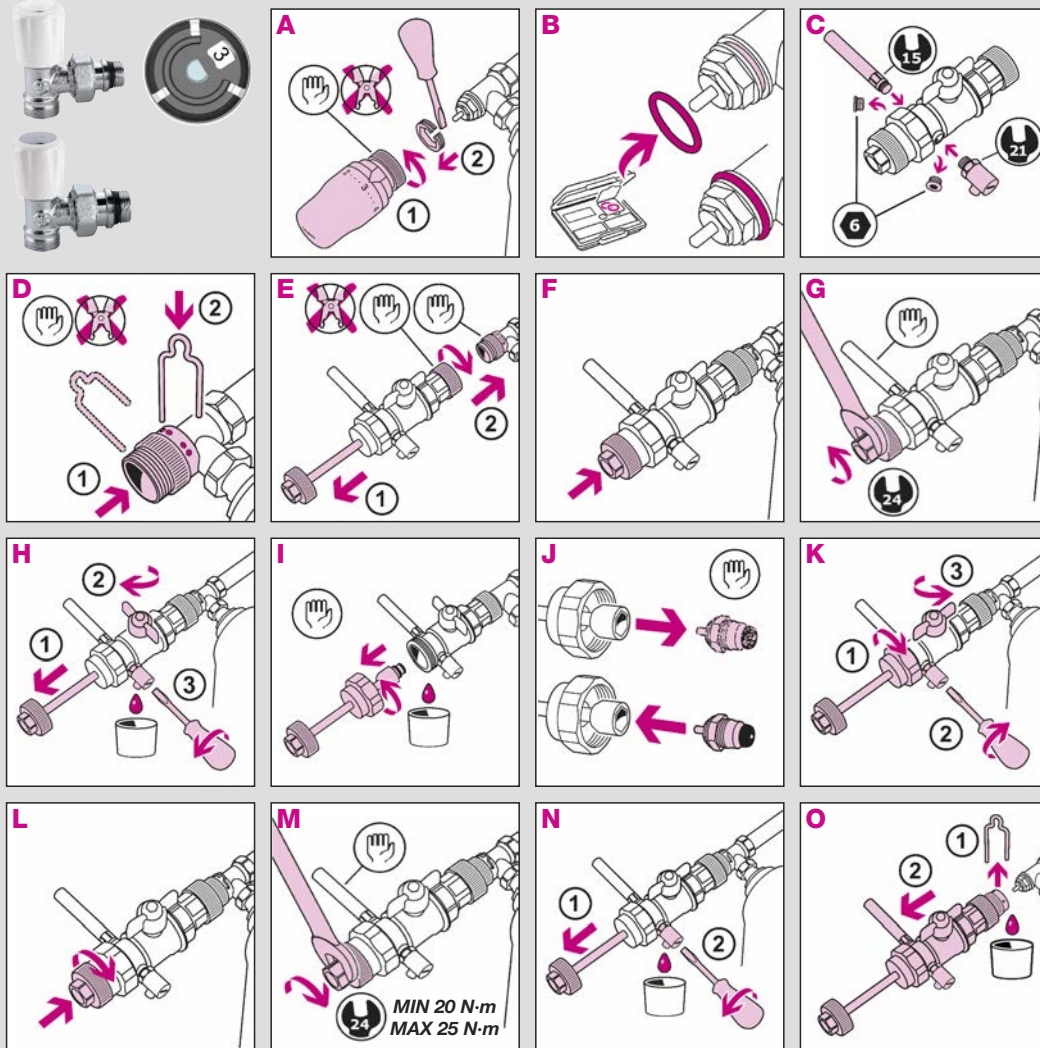

**PROCEDURA PER VALVOLE TERMOSTATICHE
PROCEDURE FOR THERMOSTATIC RADIATOR VALVES**

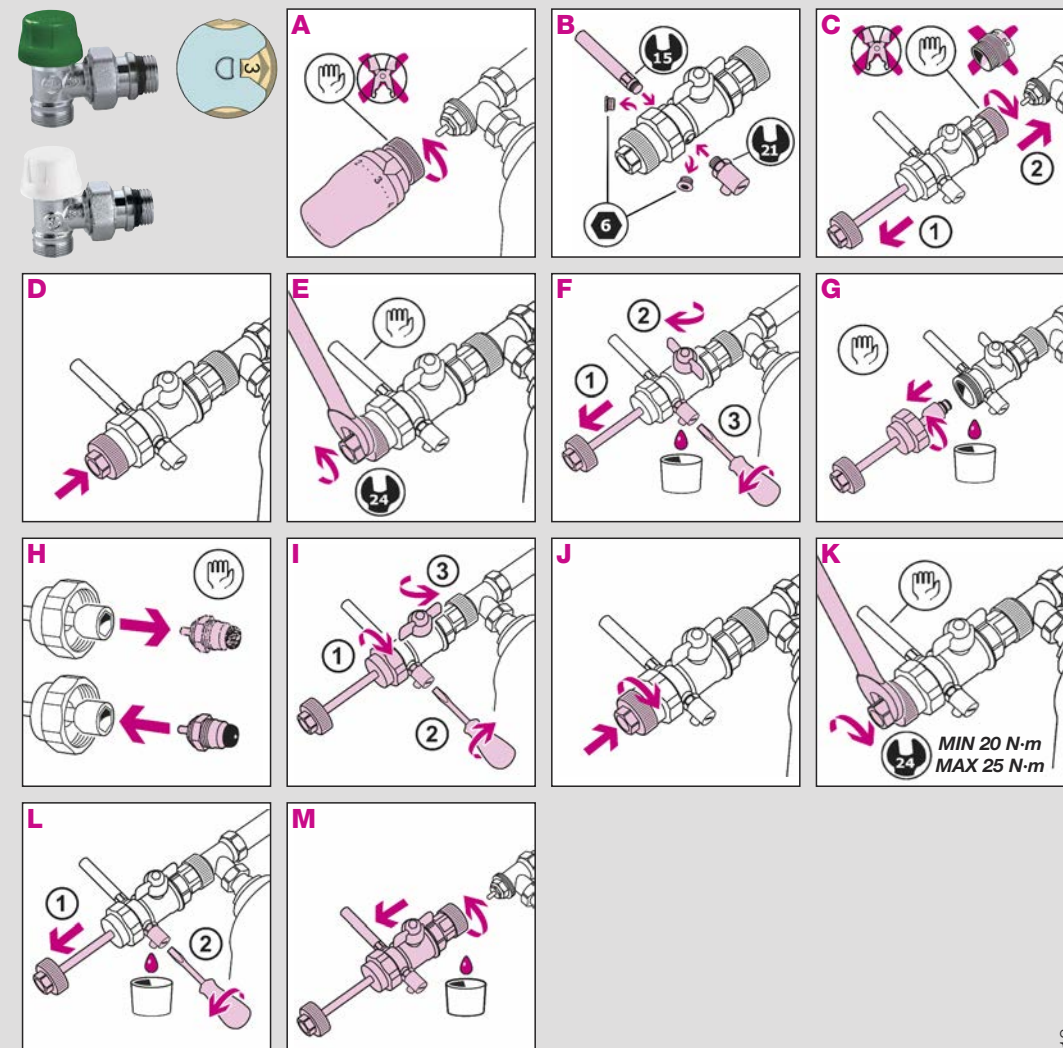

NOTA: Per completamento procedura pre-regolabili vedi foglio istruzioni dedicato.

NOTE: For the complete procedure with convertible radiator valves with pre-setting, please refer to the specific instruction sheet.